

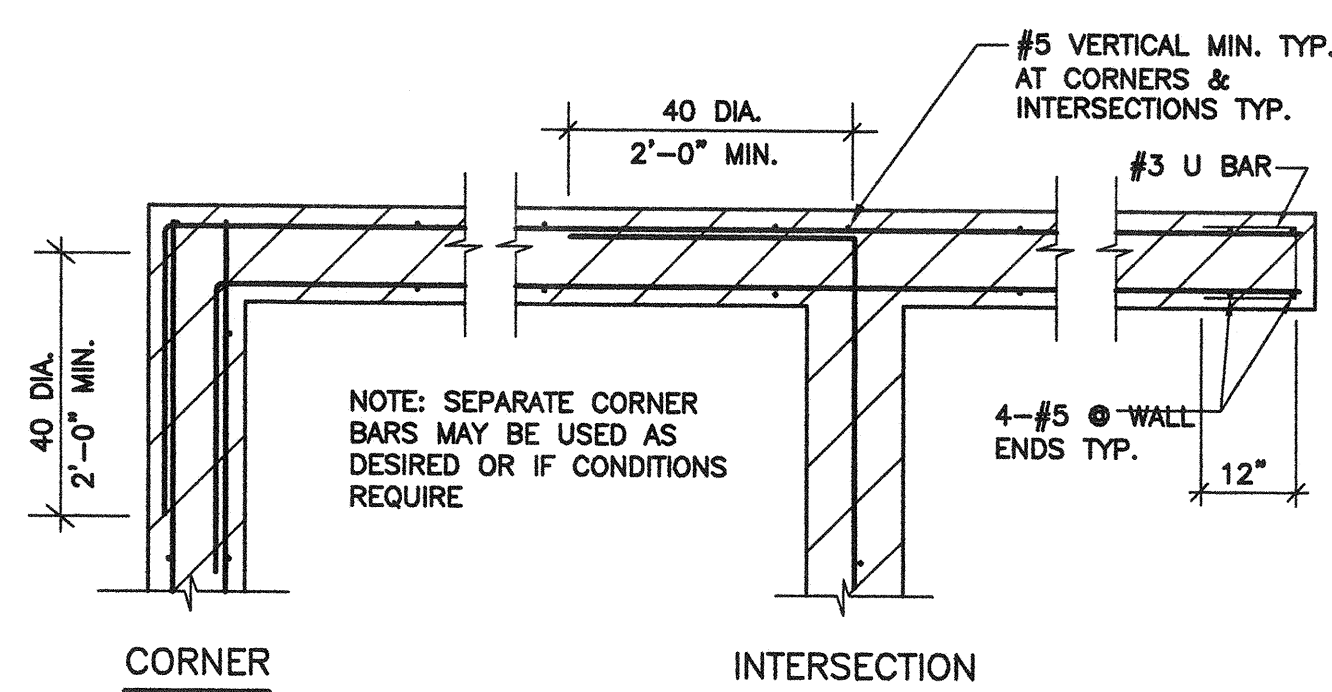
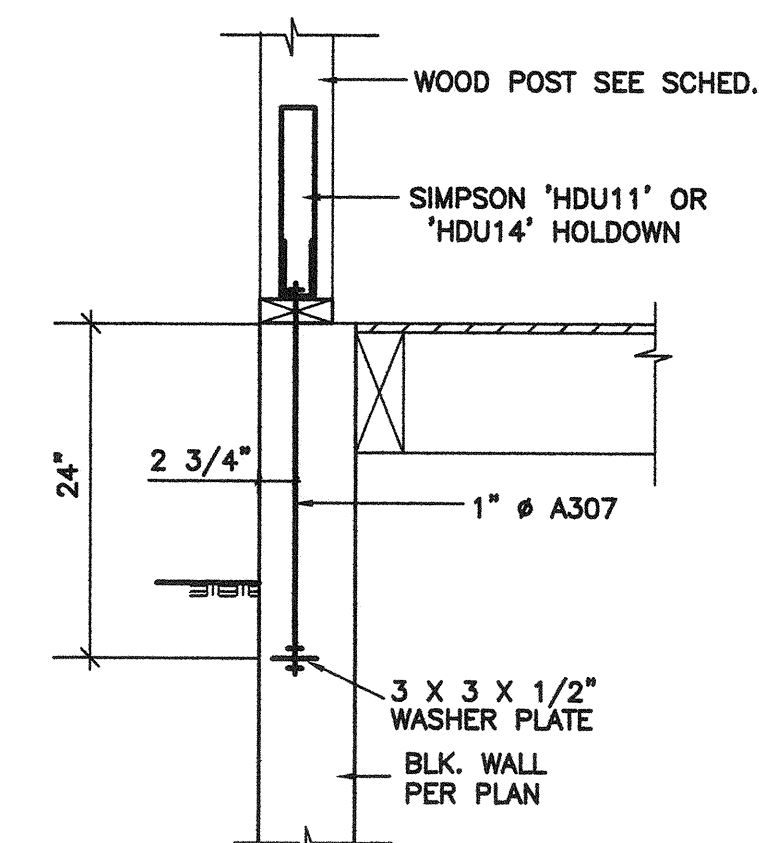
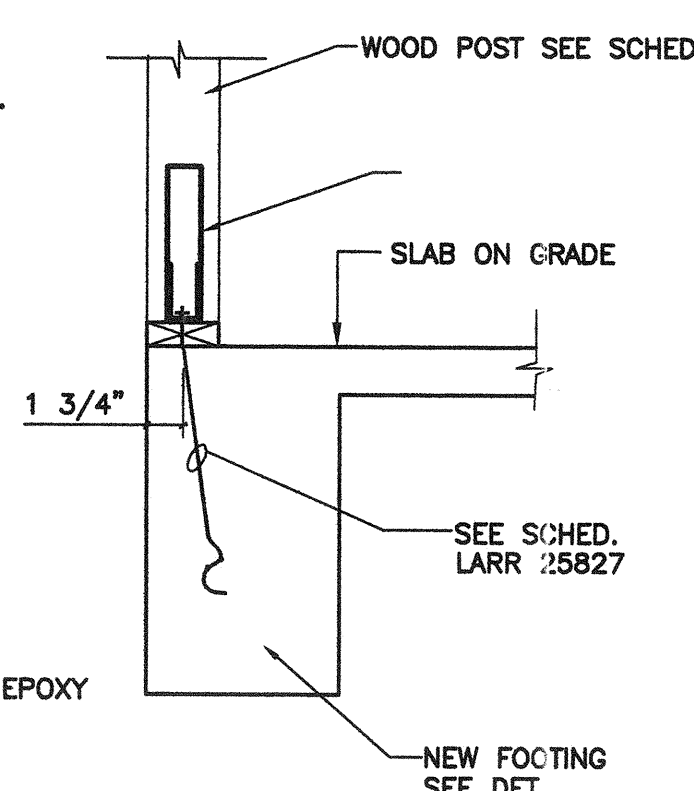
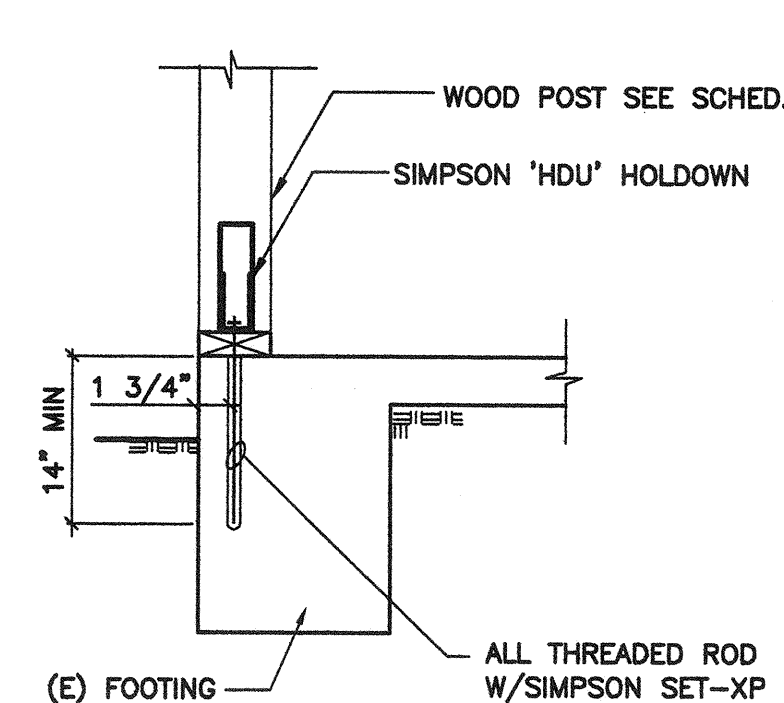
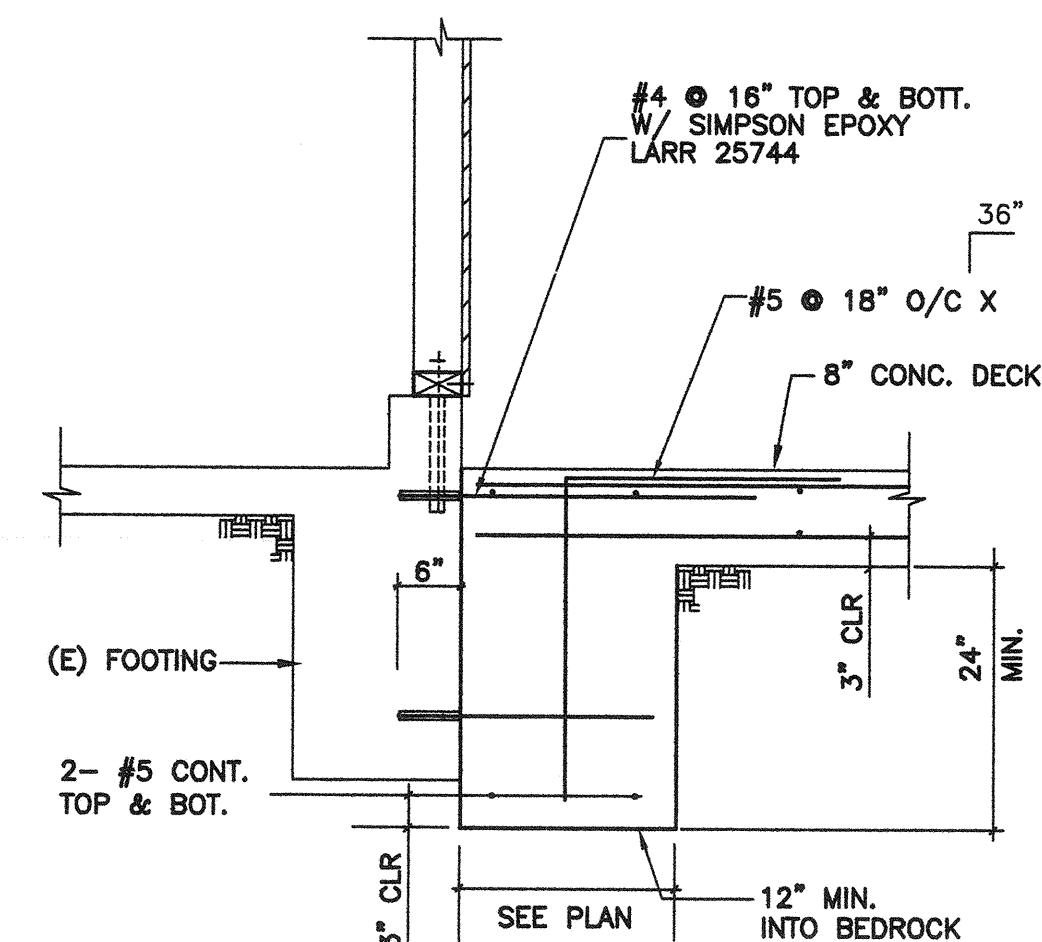
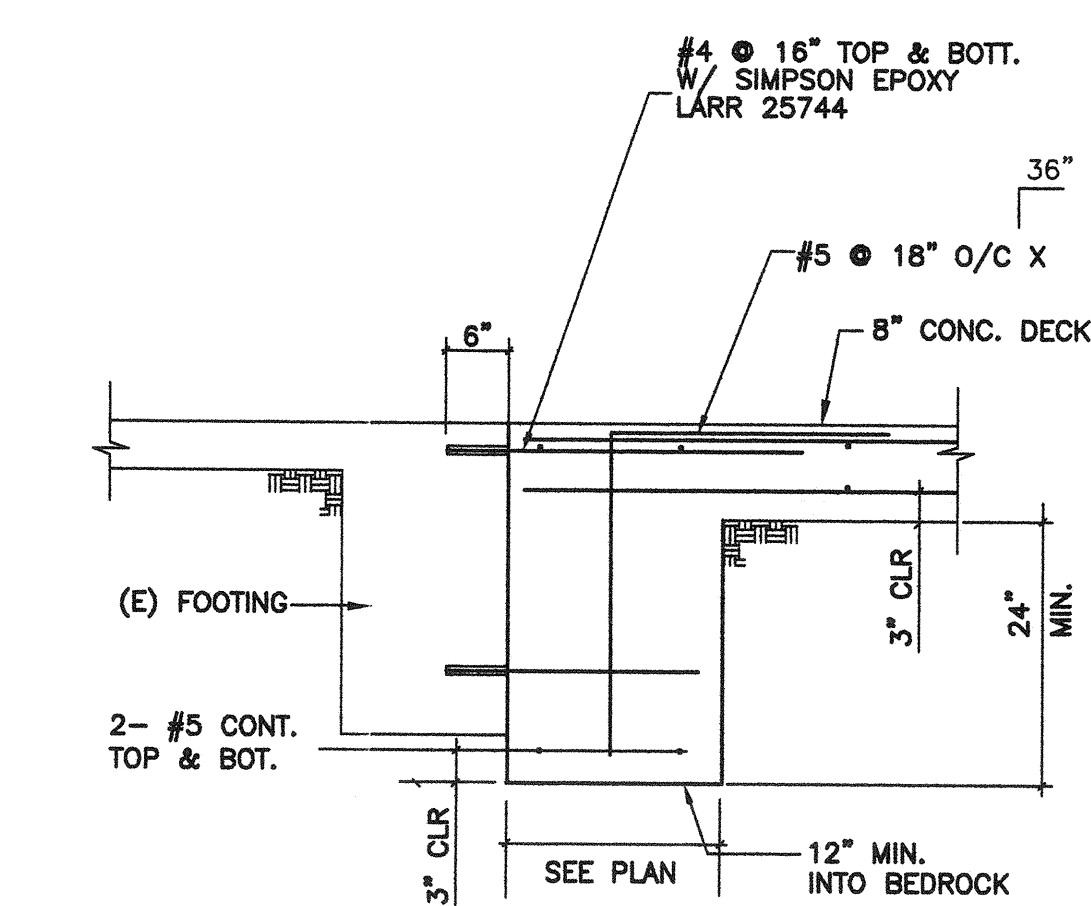
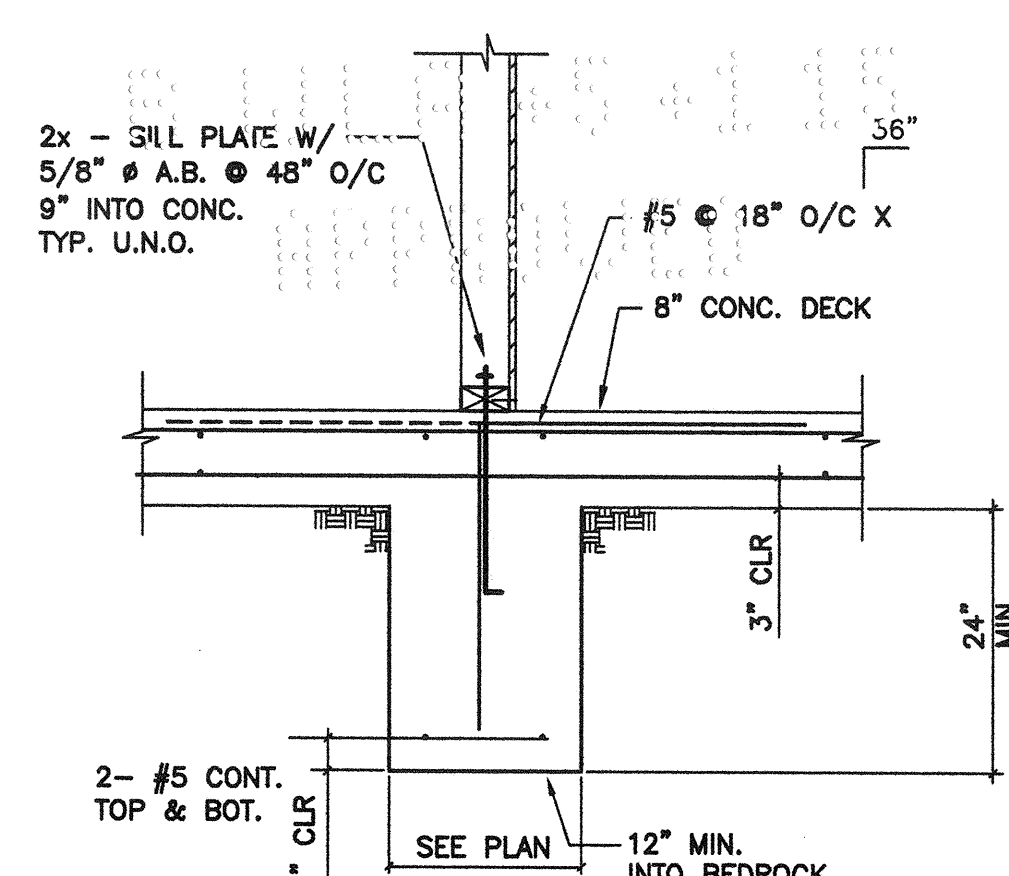
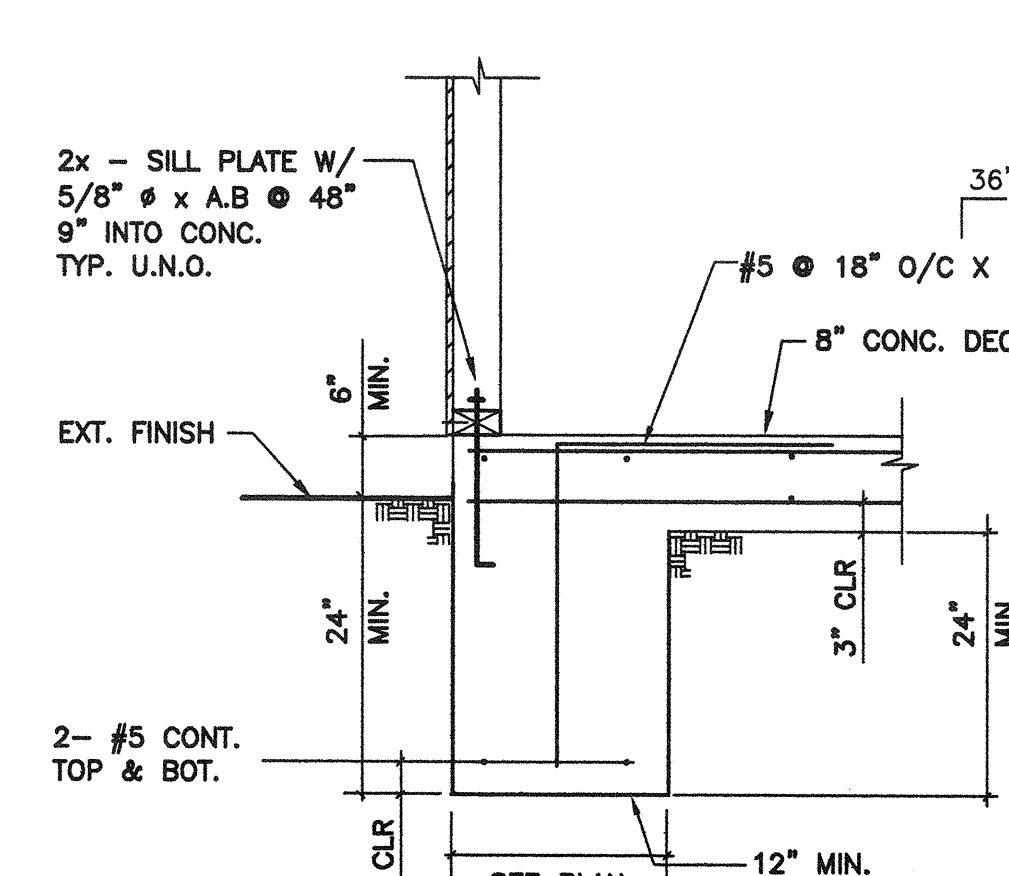
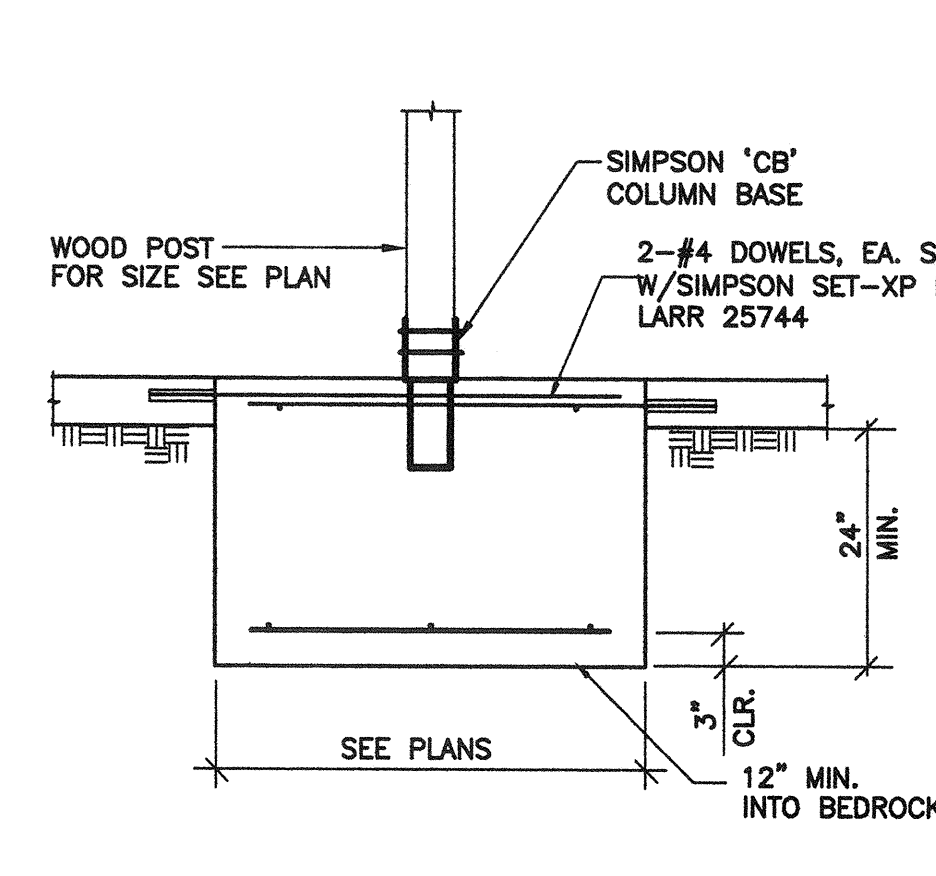


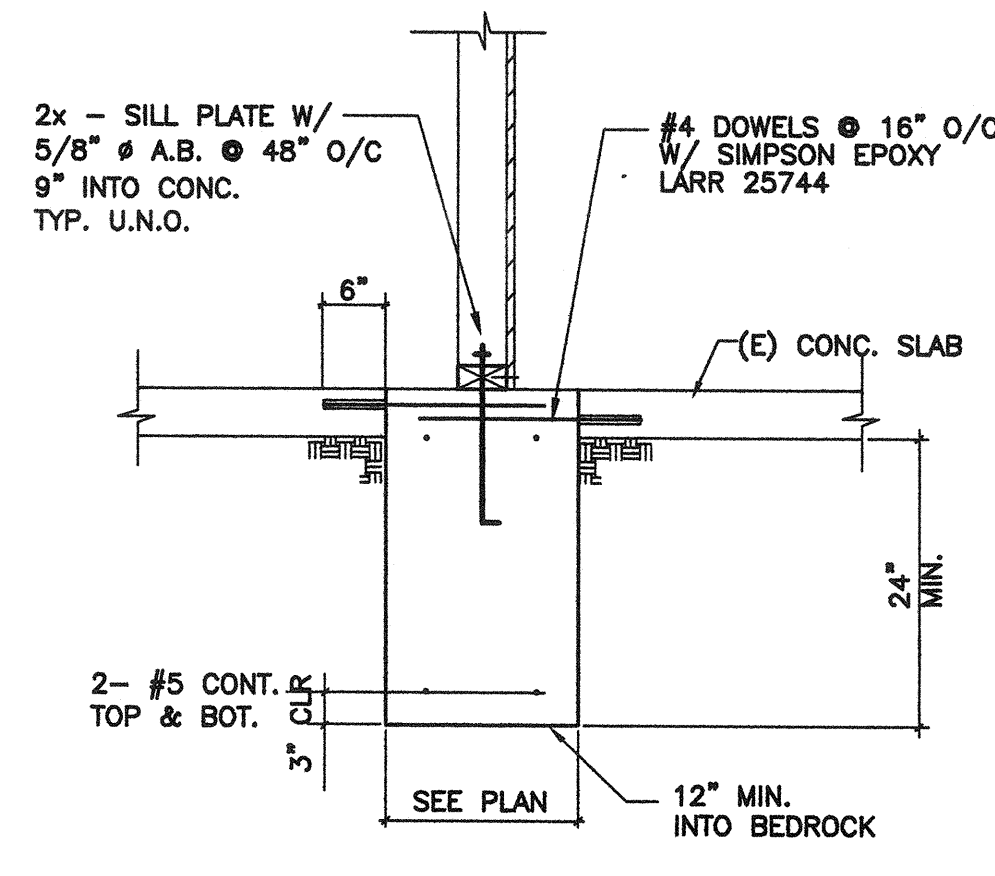







MASONRY WALL PLAN DETAIL

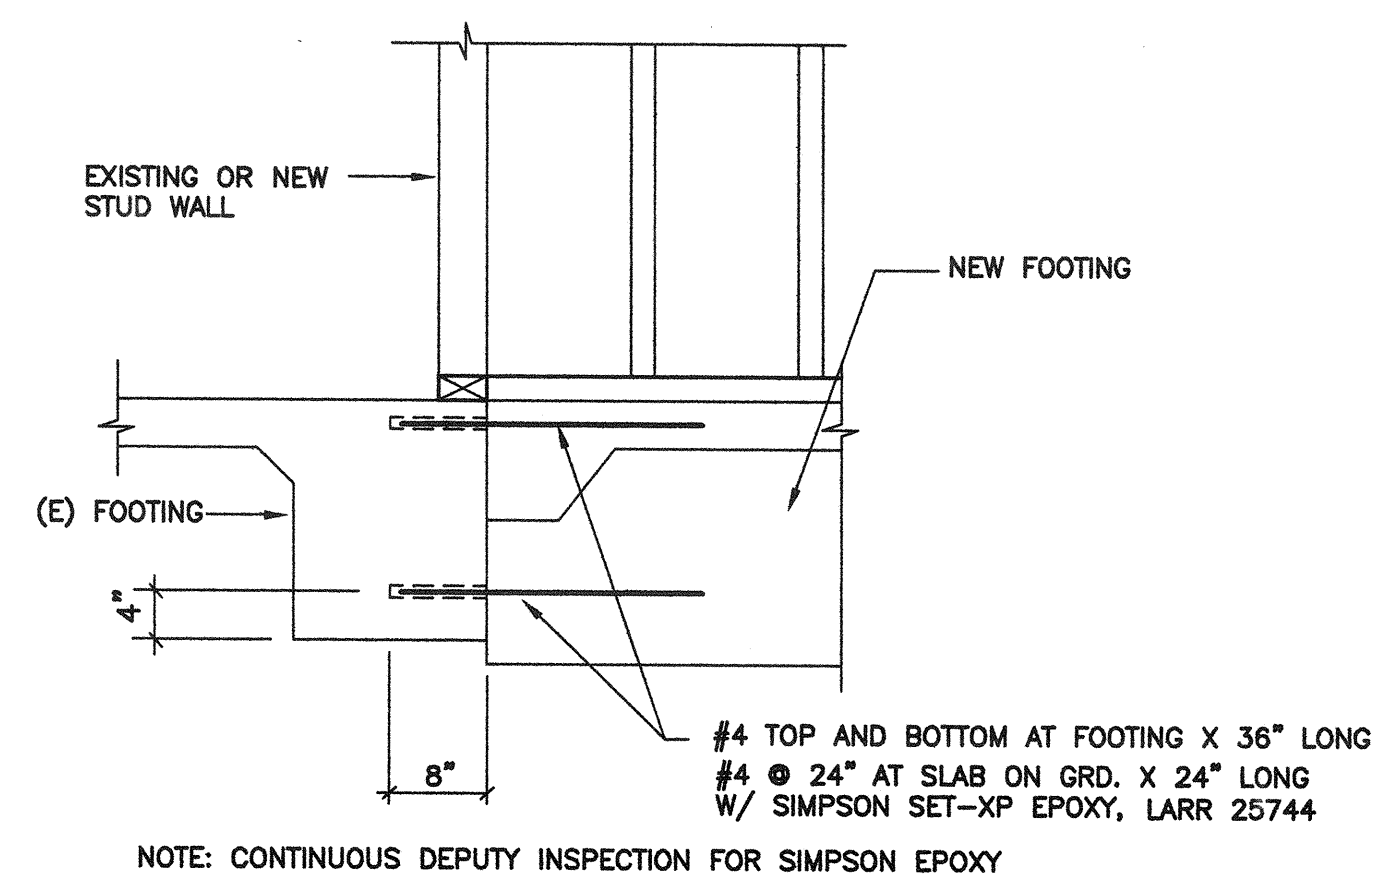





SIMPSON HOLDOWN SCHEDULE		
HOLDOWN	POST SIZE (MIN.)	ANCHOR BOLTS
HDU2	4 X -	SIMPSON SSTB24
HDU4	4 X -	SIMPSON SSTB24
HDU5	4 X -	SIMPSON SSTB24
HDU8	4 X -	SIMPSON SSTB28
HDU14	6 X 6 OR 4 X 8	1" @ A307 W/ 3" SQ. X 1/2" WASH. PLATE
HD19	6 X 6 OR 4 X 8	1 1/4" @ A307 W/ 3" SQ. X 1/2" WASH. PLATE

LARR 25720 - SIMPSON HDU
LARR 25827 - SIMPSON SSTB

HDU11, HDU14, HD19

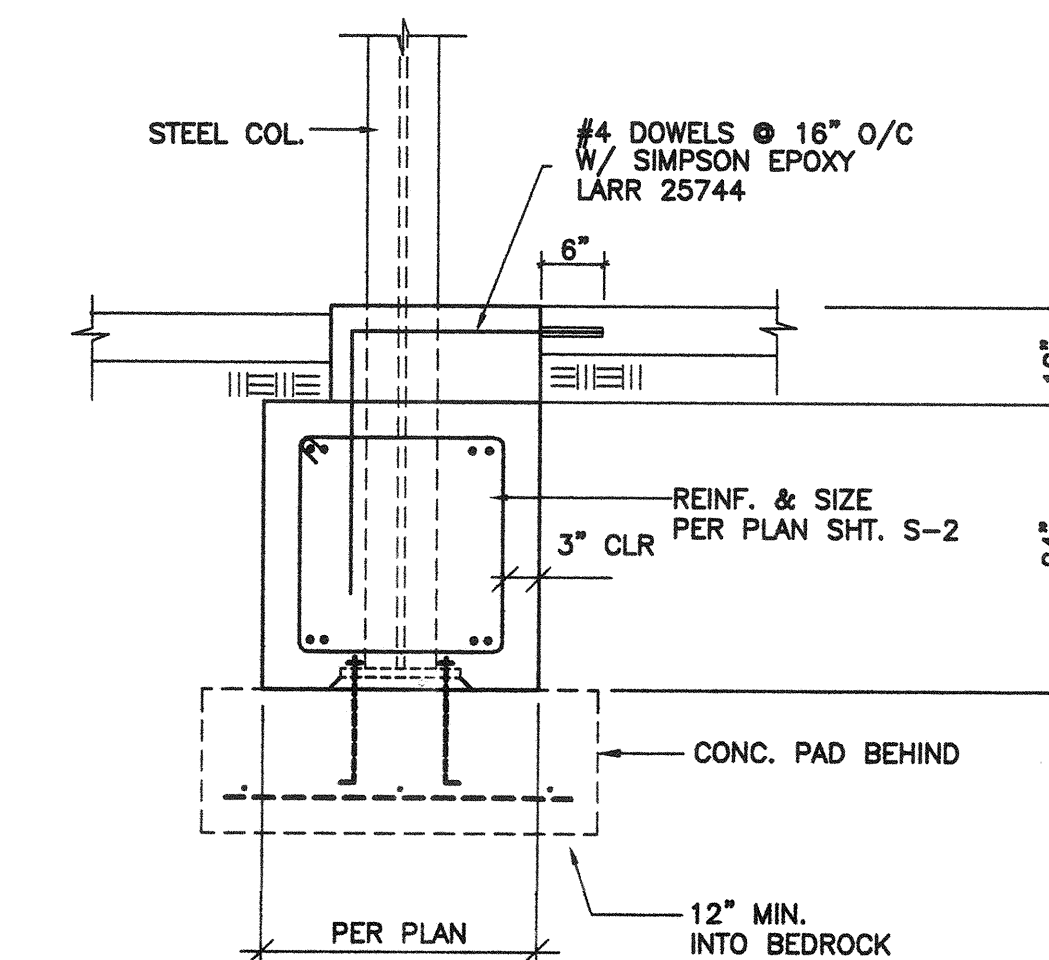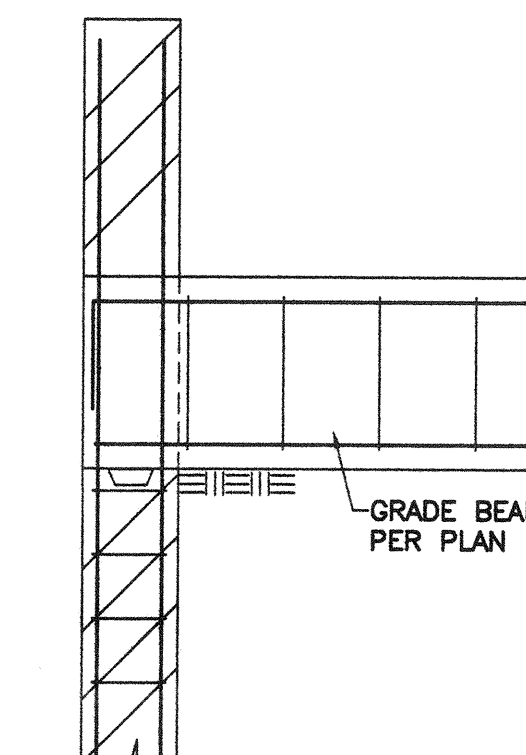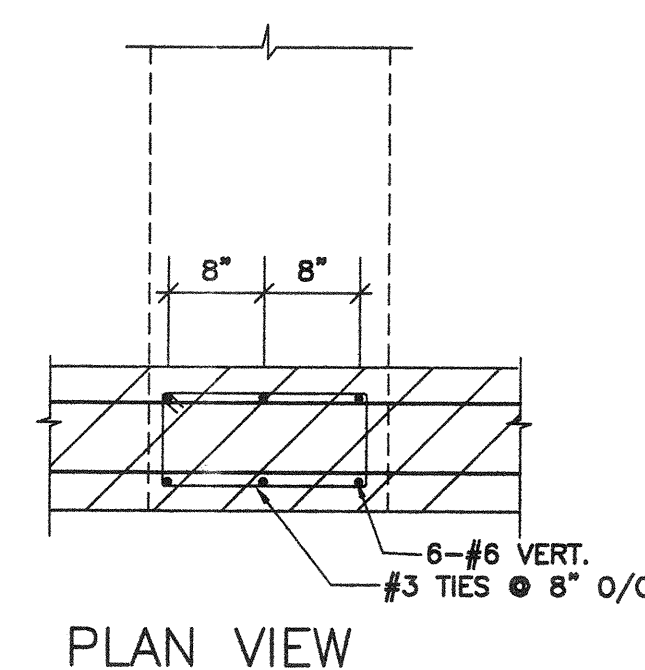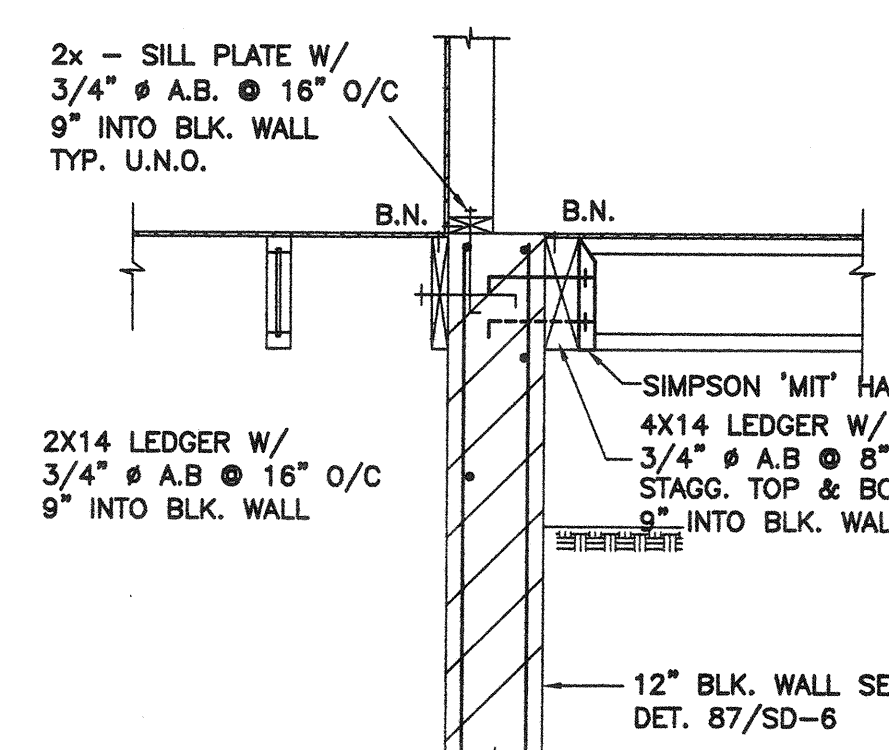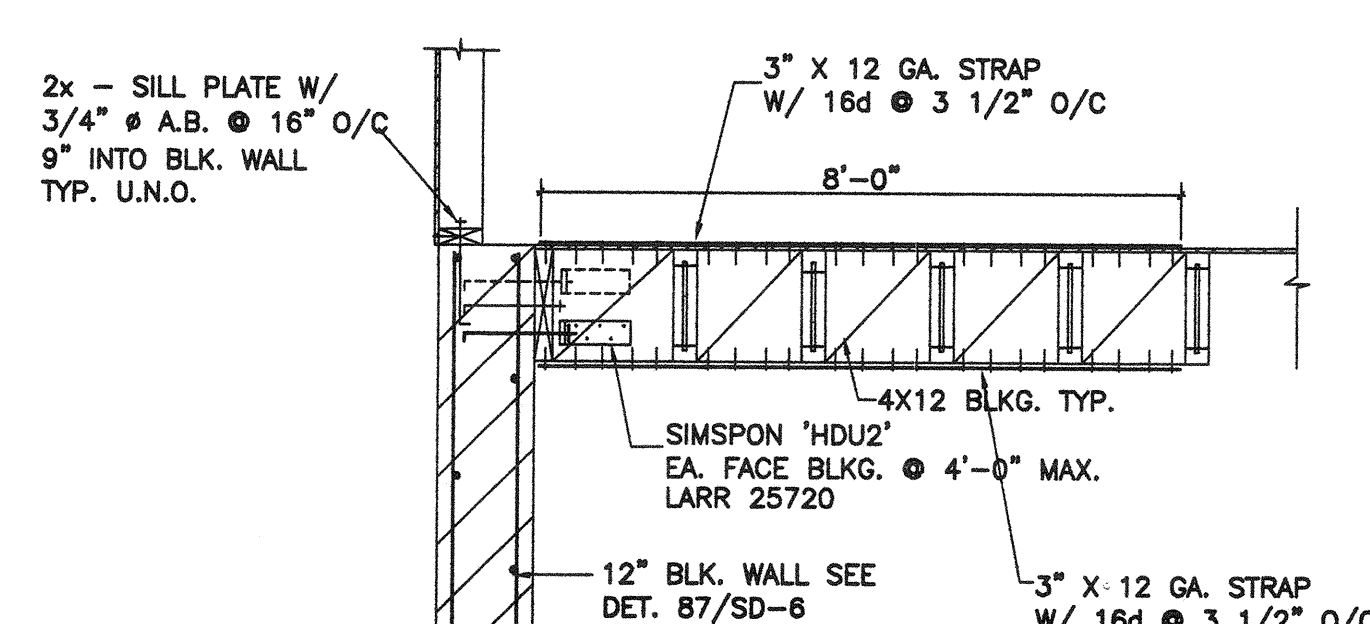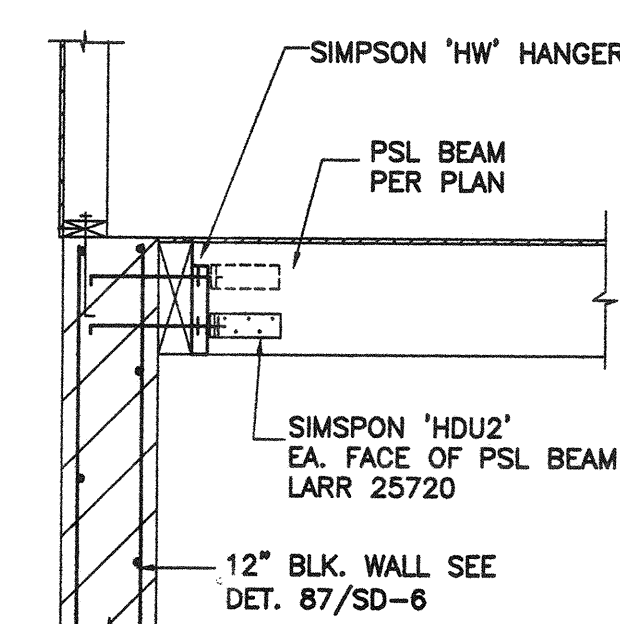

NOTE: DO NOT BACKFILL UNTIL TOP OF WALL ARE RESTRAINED AND SECURED WITH WOOD FLOOR

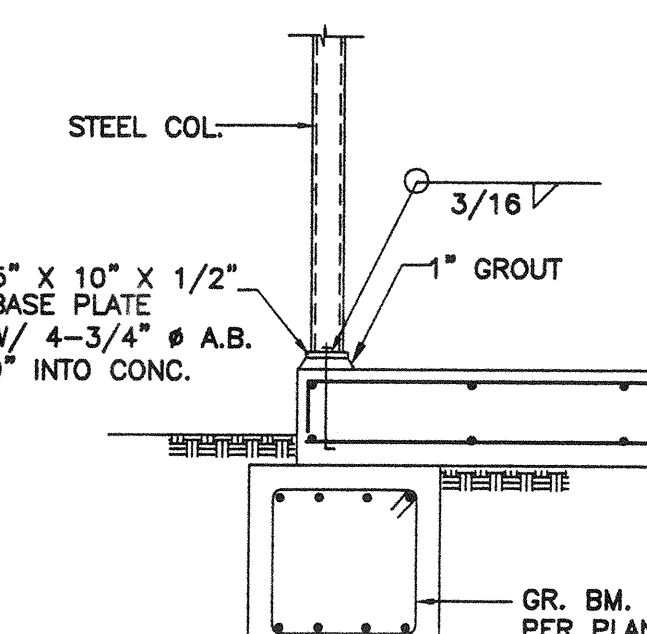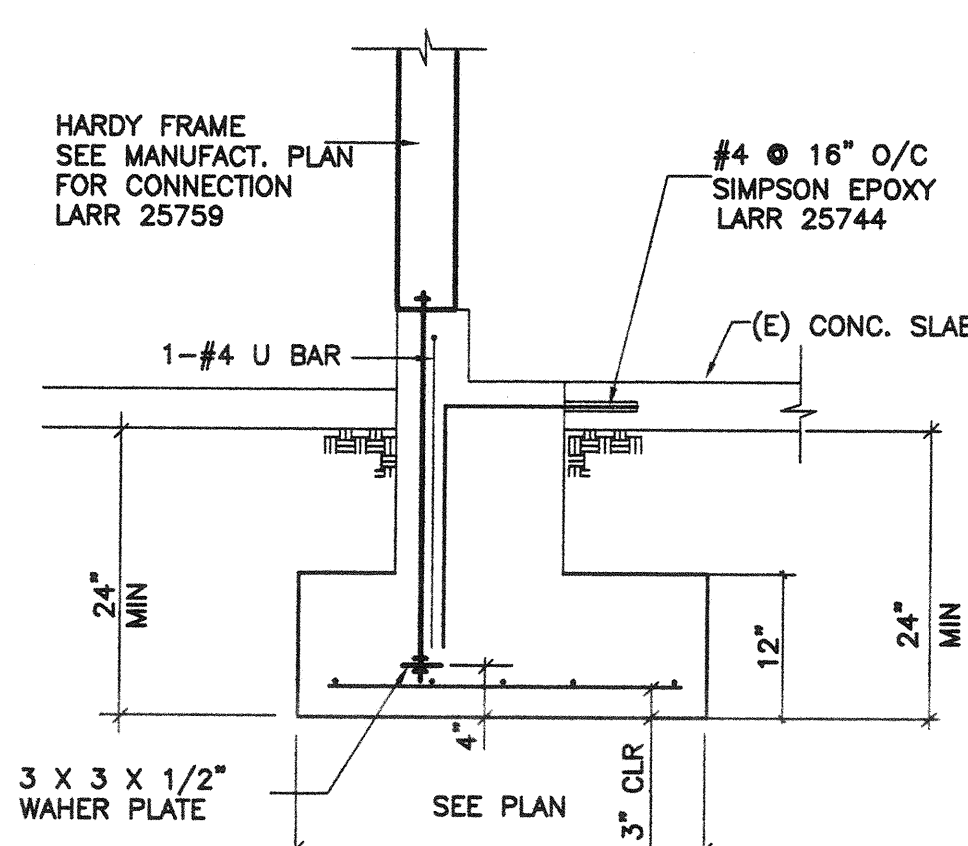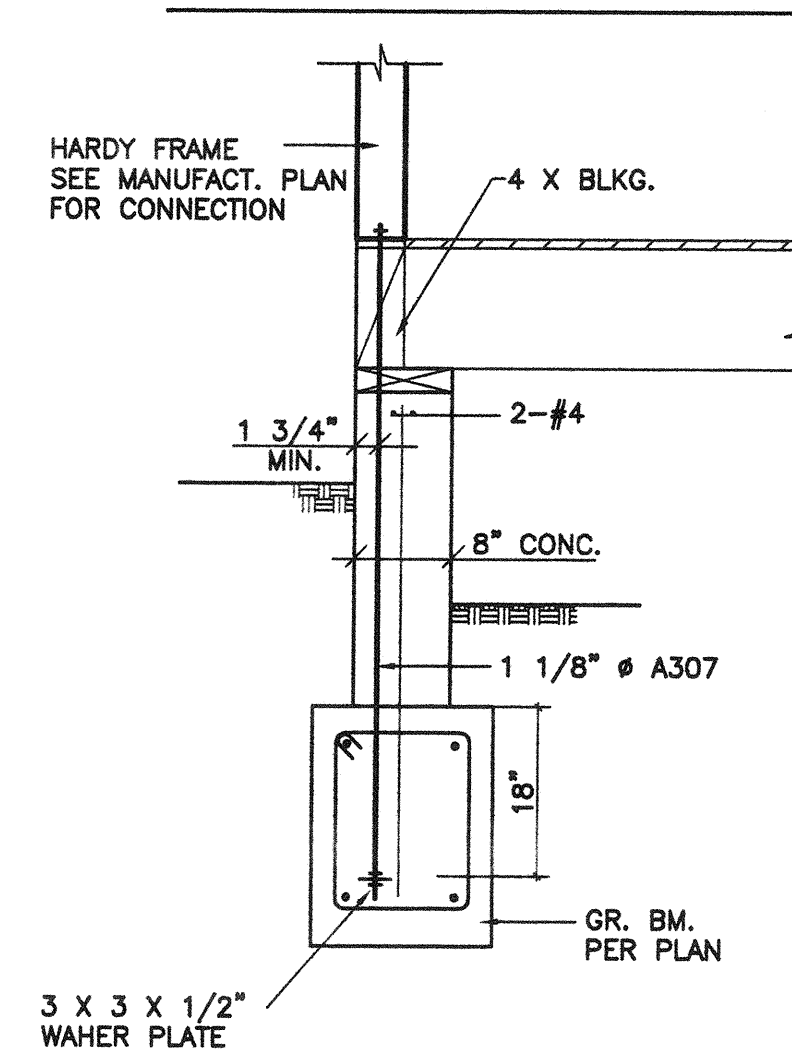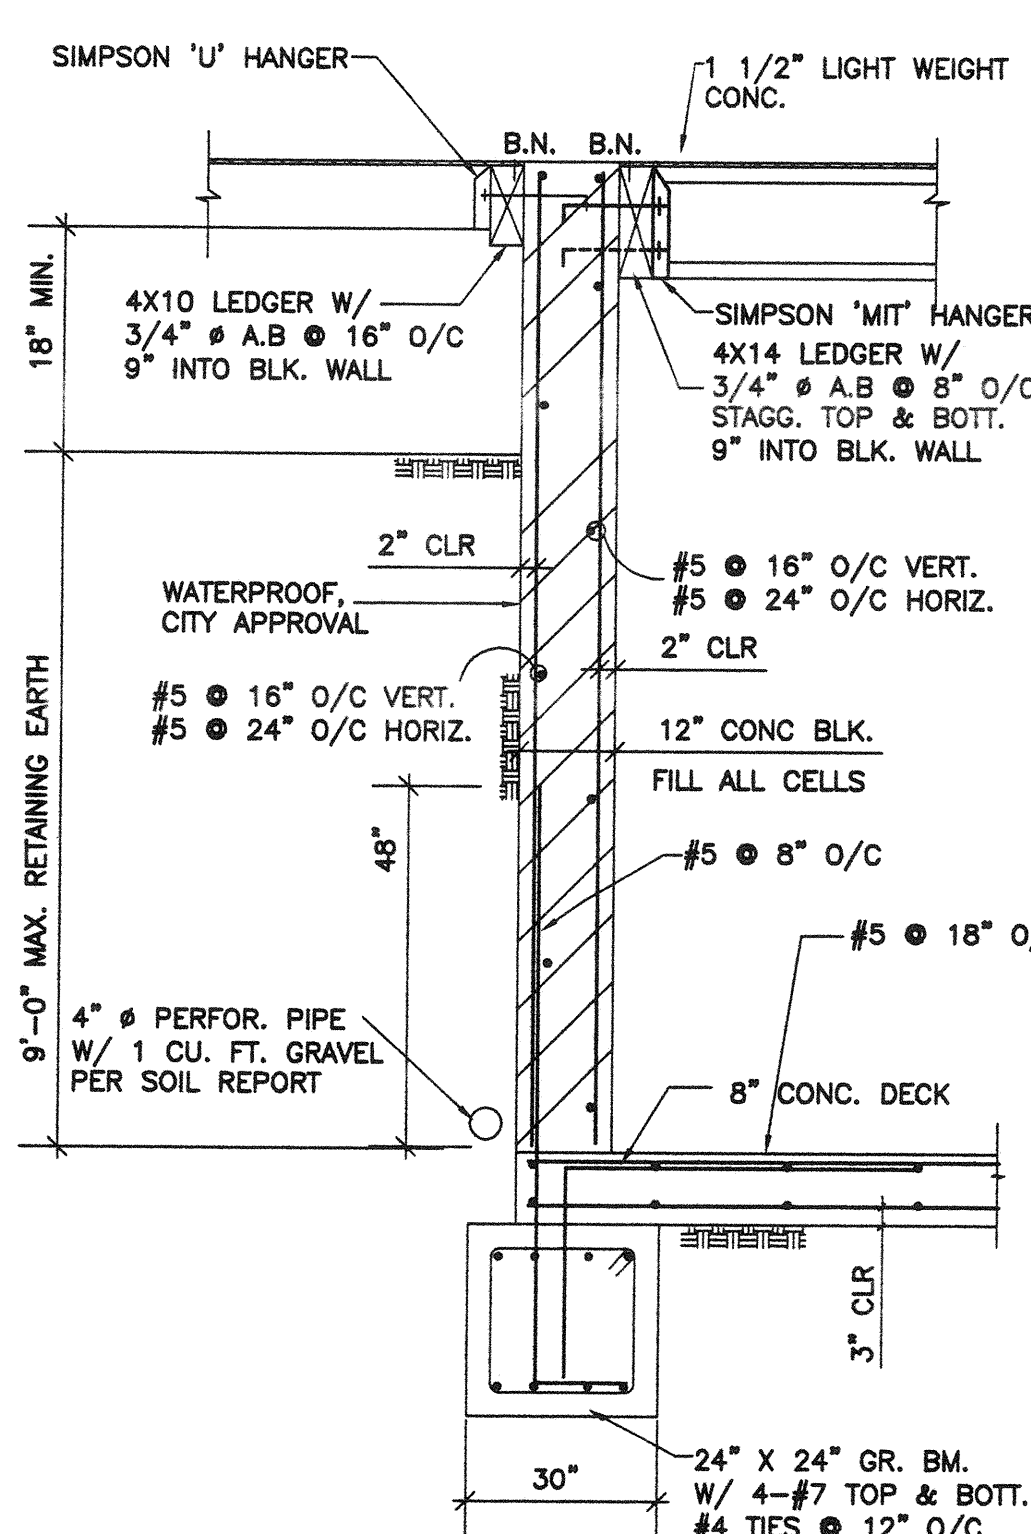

THESE PLANS HAVE BEEN REVIEWED BY BYER
GEOTECHNICAL INC. AND CONFORM TO THE
GEOTECHNICAL RECOMMENDATIONS
CONTAINED IN THE REPORT.

BQ 22056 DATE 12/24/14
10/22/15 4/28/16
EC 1804